


SPRINKLED BUILDING

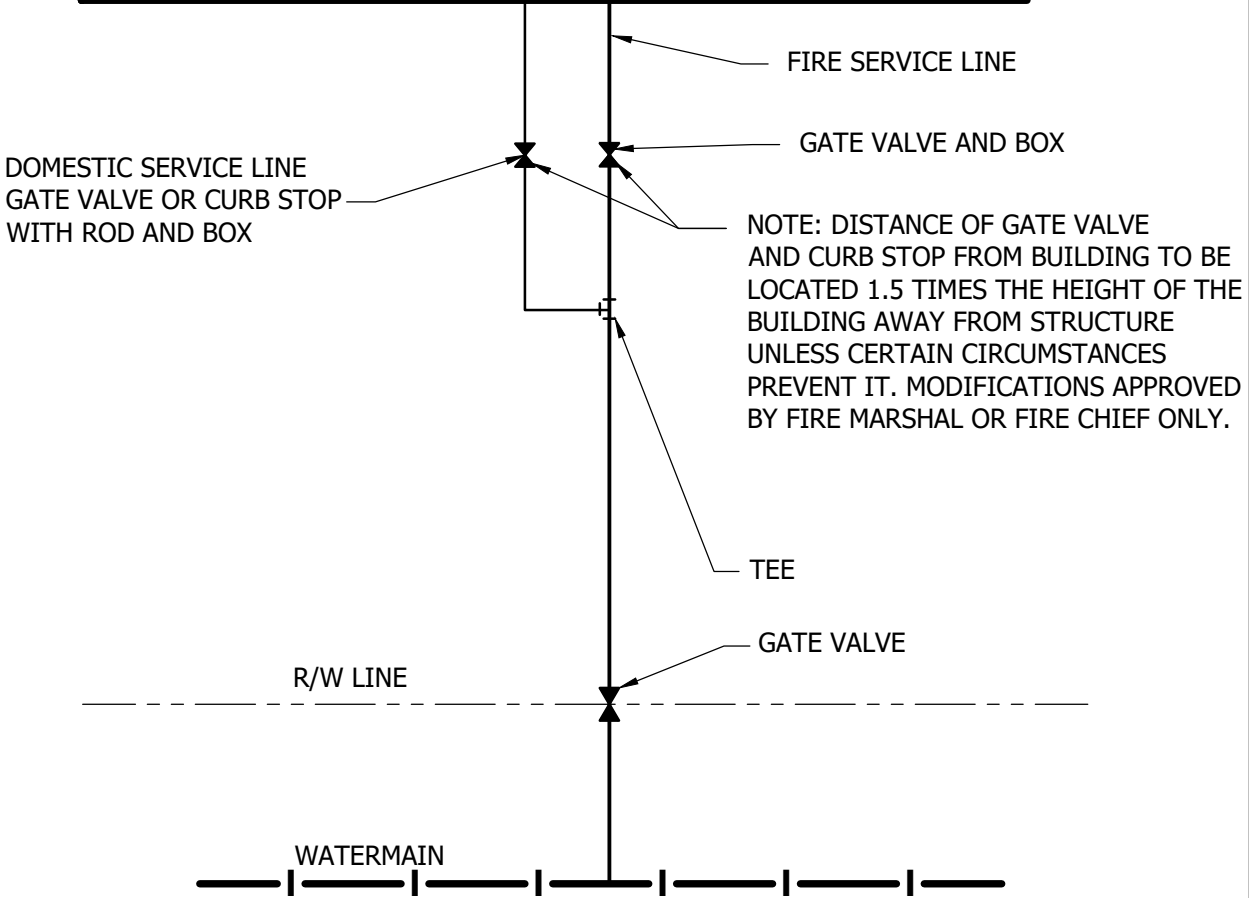

FIRE SERVICE LINE

GATE VALVE AND BOX

DOMESTIC SERVICE LINE
GATE VALVE OR CURB STOP
WITH ROD AND BOX

NOTE: DISTANCE OF GATE VALVE
AND CURB STOP FROM BUILDING TO BE
LOCATED 1.5 TIMES THE HEIGHT OF THE
BUILDING AWAY FROM STRUCTURE
UNLESS CERTAIN CIRCUMSTANCES
PREVENT IT. MODIFICATIONS APPROVED
BY FIRE MARSHAL OR FIRE CHIEF ONLY.

TEE

GATE VALVE

R/W LINE

WATERMAIN



BUILDING SPRINKLER SERVICE

LAST REVISION:
JAN 2017

PLATE NO.
SER-6